




**AT CURB-SEPARATED SIDEWALK LOCATION**

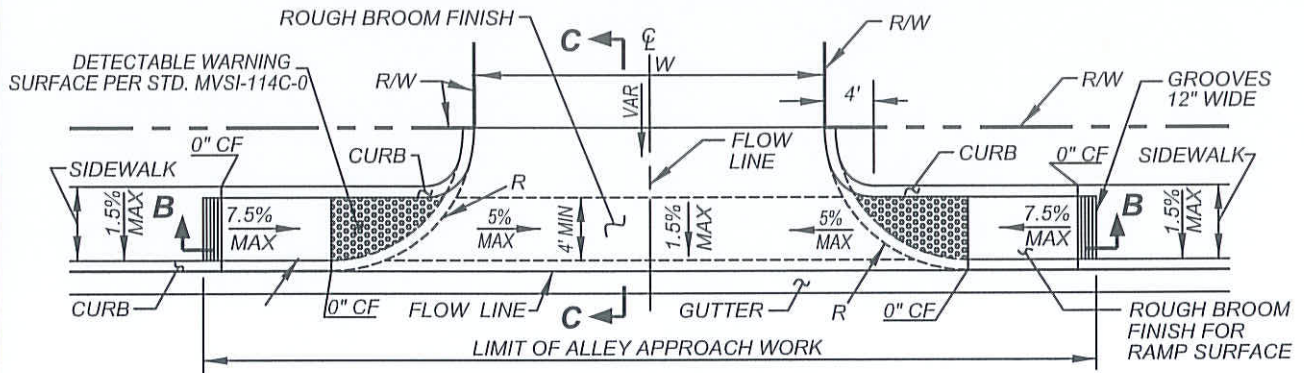


**AT CURB-ADJACENT SIDEWALK LOCATION**

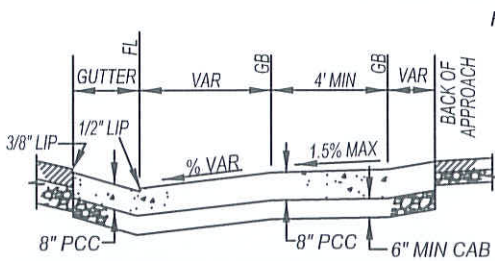

**SECTION "A-A"**

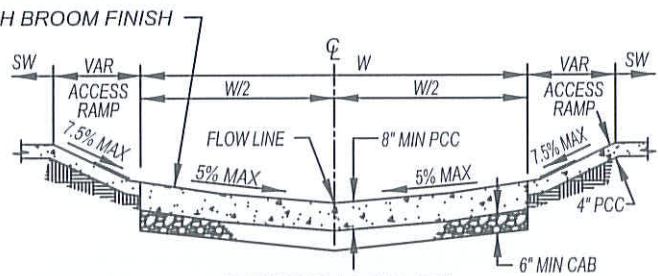

**SECTION "B-B"**

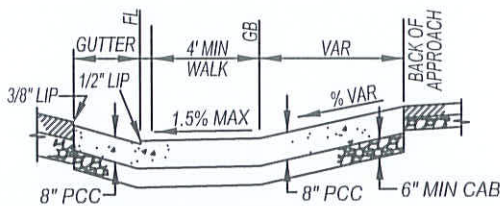


**SECTION "C-C"**

**NOTES:**

- 1.) CURB RETURNS SHALL HAVE A RADIUS (R) OF 12 FEET UNLESS OTHERWISE SPECIFIED. CURB RADIUS SHALL NOT EXCEED PARKWAY WIDTH.
- 2.) ALL CONCRETE SHALL BE CLASS 560-C-3250, CURED WITH WHITE PIGMENTED CURING COMPOUND.
- 3.) RAMP SURFACE SHALL BE SLIP-RESISTANT WITH ROUGH BROOM FINISH OR EQUIVALENT.

NOT TO SCALE



RECOMMENDED:

*[Signature]*  
DIVISION MANAGER / 1/21/14  
DATE

APPROVED:

*[Signature]*  
PUBLIC WORKS DIRECTOR / 1/20/14  
CITY ENGINEER / DATE

**CITY OF MORENO VALLEY**  
PUBLIC WORKS DEPARTMENT - CAPITAL PROJECTS DIVISION

**ALLEY APPROACH**

STANDARD PLAN  
**MVSI-113-0**

SHEET 1 OF 1